


DAFTAR PUSTAKA

- Ahmad Ardiansyah, **Analisis Keandalan Sistem Jaringan Distribusi Udara 20 kV**, 2010
- B.L. Theraja. **Text Book of Electrical Tecnology**, New Delhi; Publication. Division of Nirja Construction & Development, 1984.
- Rieger, Heinz. 1987. Tegangan bolak-balik, Arus bolak-balik. Siemens
- PT.PLN (Persero), **Buku 4 Standar Konstruksi Gardu Distribusi dan Gardu Hubung Tenaga Listrik**, Jakarta, 2010.
- Sallam, A. A. (Abdelhay. A.). O.P. Malik. **Electric distribution systems**. Published by John Wiley & Sons, Inc., Hoboken, New Jersey.2010
- Sanjeev Sarma. 2007. Basic of Electrical Engineering. Madan Mohan Malviya Engineering College, Gorakhpur (U.P.)
- Schneider Electric, **Power Quality Monitoring Described in IEEE 1159**, Electrical Distribution Solution, Industry-Building
- William D. Stevenson, Jr, 1993,. **“Analisa Sistem Tenaga Listrik”**. Penerbit Erlangga
- Zuhal. 2000. **Dasar Teknik Tenaga listrik dan Elektronika Daya**. Gramedia Pustaka Utama: Jakarta

DOKUMENTASI PENELITIAN



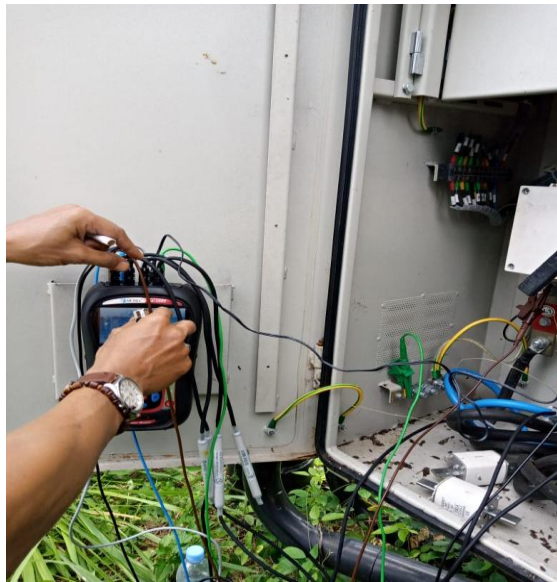




DISTRIBUTION TRANSFORMER

HERMETICALLY SEALED (SPLN D3.002-1 : 2007)

PHASE	3	FREQUENCY (Hz)	50
VECTOR GROUP	Dyn5	RATED POWER (kVA)	200
COOLING	ONAN	HV CURRENT (A)	5.774
HIGH VOLTAGE (V)	20000	LV CURRENT (A)	288.675
LOW VOLTAGE (V)	400	AMBIENT TEMP (°C)	40
IMPEDANCE 75°C (%)	4.00	OIL TEMP RISE (°C)	50
HV BIL (kV)	125	WDG. TEMP RISE (°C)	55
NO-LOAD LOSS (W)	355	OIL VOLUME (L)	287
FULL LOAD LOSS (W)	2350	TOTAL WEIGHT (kg)	1220
HV-LV WINDING MAT.	AL - AL	MFG. DATE	01 - 201
INSULATING OIL	MINERAL	SERIAL NO.	170013

Tap 1 : 21000 V
Tap 2 : 20500 V
Tap 3 : 20000 V
Tap 4 : 19500 V
Tap 5 : 19000 V
Tap 6 : 18500 V
Tap 7 : 18000 V

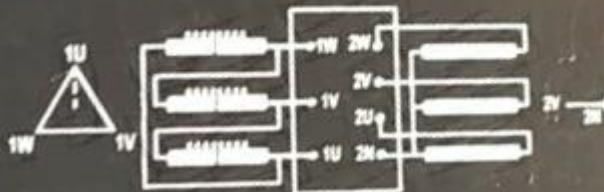

B&D PT. BAMBANG DJAJA • RUNGKUT INDUSTRI III/56, SURABAYA
 PHONE: (62) 31-8438703 • FAX: (62) 31-8438350



Nameplate Speksifikasi Transformator